



IEC 61784-5-2

Edition 4.1 2024-03  
CONSOLIDATED VERSION

# INTERNATIONAL STANDARD



---

**Industrial communication networks – Profiles –  
Part 5-2: Installation of fieldbuses – Installation profiles for CPF 2**

INTERNATIONAL  
ELECTROTECHNICAL  
COMMISSION

---

ICS 25.040.40; 35.100.40

ISBN 978-2-8322-8624-1

**Warning! Make sure that you obtained this publication from an authorized distributor.**

CONTENTS

- FOREWORD..... 10
- INTRODUCTION..... 12
- INTRODUCTION to Amendment 1 ..... 14
- 1 Scope..... 15
- 2 Normative references ..... 15
- 3 Terms, definitions and abbreviated terms ..... 15
- 4 CPF 2: Overview of installation profiles ..... 16
- 5 Installation profile conventions ..... 16
- 6 Conformance to installation profiles..... 17
- Annex A (normative) CP 2/1 (ControlNet™) specific installation profile ..... 18
  - A.1 Installation profile scope ..... 18
  - A.2 Normative references..... 18
  - A.3 Installation profile terms, definitions, and abbreviated terms ..... 18
    - A.3.1 Terms and definitions ..... 18
    - A.3.2 Abbreviated terms ..... 18
    - A.3.3 Conventions for installation profiles ..... 18
  - A.4 Installation planning..... 19
    - A.4.1 General ..... 19
    - A.4.2 Planning requirements ..... 20
    - A.4.3 Network capabilities..... 21
    - A.4.4 Selection and use of cabling components ..... 27
    - A.4.5 Cabling planning documentation ..... 45
    - A.4.6 Verification of cabling planning specification..... 45
  - A.5 Installation implementation ..... 45
    - A.5.1 General requirements ..... 45
    - A.5.2 Cable installation ..... 45
    - A.5.3 Connector installation ..... 47
    - A.5.4 Terminator installation ..... 56
    - A.5.5 Device installation ..... 56
    - A.5.6 Coding and labelling ..... 58
    - A.5.7 Earthing and bonding of equipment and devices and shield cabling ..... 59
    - A.5.8 As-implemented cabling documentation ..... 60
  - A.6 Installation verification and installation acceptance test ..... 60
    - A.6.1 General ..... 60
    - A.6.2 Installation verification ..... 60
    - A.6.3 Installation acceptance test ..... 63
  - A.7 Installation administration ..... 65
  - A.8 Installation maintenance and installation troubleshooting ..... 65
    - A.8.1 General ..... 65
    - A.8.2 Maintenance ..... 65
    - A.8.3 Troubleshooting..... 65
    - A.8.4 Specific requirements for maintenance and troubleshooting..... 70
- Annex B (normative) CP 2/2 (EtherNet/IP™) specific installation profile..... 71
  - B.1 Installation profile scope ..... 71
  - B.2 Normative references..... 71
  - B.3 Installation profile terms, definitions, and abbreviated terms ..... 72

B.3.1	Terms and definitions .....	72
B.3.2	Abbreviated terms .....	72
B.3.3	Conventions for installation profiles .....	72
B.4	Installation planning .....	72
B.4.1	General .....	72
B.4.2	Planning requirements .....	73
B.4.3	Network capabilities .....	74
B.4.4	Selection and use of cabling components .....	80
B.4.5	Cabling planning documentation .....	97
B.4.6	Verification of cabling planning specification .....	97
B.5	Installation implementation .....	97
B.5.1	General requirements .....	97
B.5.2	Cable installation .....	97
B.5.3	Connector installation .....	98
B.5.4	Terminator installation .....	100
B.5.5	Device installation .....	100
B.5.6	Coding and labelling .....	100
B.5.7	Earthing and bonding of equipment and devices and shield cabling .....	100
B.5.8	As-implemented cabling documentation .....	102
B.6	Installation verification and installation acceptance test .....	102
B.6.1	General .....	102
B.6.2	Installation verification .....	102
B.6.3	Installation acceptance test .....	103
B.7	Installation administration .....	104
B.8	Installation maintenance and installation troubleshooting .....	105
Annex C (normative)	CP 2/3 (DeviceNet™) specific installation profile .....	106
C.1	Installation profile scope .....	106
C.2	Normative references .....	106
C.3	Installation profile terms, definitions, and abbreviated terms .....	106
C.3.1	Terms and definitions .....	106
C.3.2	Abbreviated terms .....	106
C.3.3	Conventions for installation profiles .....	106
C.4	Installation planning .....	107
C.4.1	General .....	107
C.4.2	Planning requirements .....	108
C.4.3	Network capabilities .....	109
C.4.4	Selection and use of cabling components .....	125
C.4.5	Cabling planning documentation .....	135
C.4.6	Verification of cabling planning specification .....	135
C.5	Installation implementation .....	135
C.5.1	General requirements .....	135
C.5.2	Cable installation .....	135
C.5.3	Connector installation .....	137
C.5.4	Terminator installation .....	150
C.5.5	Device installation .....	152
C.5.6	Coding and labelling .....	156
C.5.7	Earthing and bonding of equipment and devices and shield cabling .....	156
C.5.8	As-implemented cabling documentation .....	157
C.6	Installation verification and installation acceptance test .....	157

- C.6.1 General ..... 157
- C.6.2 Installation verification ..... 157
- C.6.3 Installation acceptance test ..... 160
- C.7 Installation administration ..... 161
- C.8 Installation maintenance and installation troubleshooting ..... 161
  - C.8.1 General ..... 161
  - C.8.2 Maintenance ..... 161
  - C.8.3 Troubleshooting ..... 161
  - C.8.4 Specific requirements for maintenance and troubleshooting ..... 161
- Annex D (informative) Additional information ..... 165
  - D.1 Network validation check sheet for CP 2/3 (DeviceNet) ..... 165
- Bibliography ..... 169

- Figure 1 – Standards relationships ..... 13
- Figure A.1 – Interconnection of CPF 2 networks ..... 19
- Figure A.2 – Overview of CPF 2/1 networks ..... 20
- Figure A.3 – Drop cable requirements ..... 22
- Figure A.4 – Placement of BNC/TNC plugs ..... 22
- Figure A.5 – Placement of terminators ..... 23
- Figure A.6 – Extending a network using repeaters ..... 23
- Figure A.7 – Extending a network using active star topology ..... 23
- Figure A.8 – Links ..... 24
- Figure A.9 – Extending the network beyond 99 nodes ..... 24
- Figure A.10 – Maximum allowable taps per segment ..... 33
- Figure A.11 – Example of repeaters in star configuration ..... 34
- Figure A.12 – Repeater in parallel ..... 35
- Figure A.13 – Repeater in combination series and parallel ..... 36
- Figure A.14 – Ring repeater ..... 36
- Figure A.15 – Installing bulkheads ..... 37
- Figure A.16 – Coaxial BNC and TNC terminators ..... 38
- Figure A.17 – Terminator placement in a segment ..... 38
- Figure A.18 – RC Shield Termination in Active Devices ..... 40
- Figure A.19 – Redundant network icons ..... 41
- Figure A.20 – Redundant coax media ..... 41
- Figure A.21 – Redundant fibre media ..... 41
- Figure A.22 – Repeater in series versus length difference for coax media ..... 42
- Figure A.23 – Repeater in series versus length difference for fibre media ..... 43
- Figure A.24 – Example of redundant coax network with repeaters ..... 43
- Figure A.25 – Example of improper redundant node connection ..... 44
- Figure A.26 – Example tool kit for installing BNC connectors ..... 48
- Figure A.27 – Calibration of coaxial stripper ..... 48
- Figure A.28 – Coax PVC strip length detail (informative) ..... 49
- Figure A.29 – Memory cartridge and blade ..... 50
- Figure A.30 – Cable position ..... 50

Figure A.31 – Locking the cable .....	50
Figure A.32 – Stripping the cable .....	51
Figure A.33 – Install the crimp ferrule .....	51
Figure A.34 – Cable preparation for PVC type cables (informative) .....	52
Figure A.35 – Cable preparation for FEP type cables (informative) .....	52
Figure A.36 – Strip guides .....	52
Figure A.37 – Using the flare tool .....	53
Figure A.38 – Expanding the shields .....	53
Figure A.39 – Install the centre pin .....	53
Figure A.40 – Crimping the centre pin .....	54
Figure A.41 – Installing the connector body .....	54
Figure A.42 – Installing the ferrule .....	54
Figure A.43 – Crimp tool .....	55
Figure A.44 – Sealed IP65/67 cable .....	56
Figure A.45 – Terminator placement .....	56
Figure A.46 – Mounting the taps .....	57
Figure A.47 – Mounting the tap assembly using the universal mounting bracket .....	58
Figure A.48 – Mounting the tap using tie wraps or screws .....	58
Figure A.49 – Redundant network icons .....	59
Figure A.50 – Network test tool .....	61
Figure A.51 – Shorting the cable to test for continuity .....	62
Figure A.52 – Testing fibre segments .....	64
Figure A.53 – Multi-fibre backbone cable housing .....	66
Figure A.54 – Repeater adapter module .....	66
Figure A.55 – Short and medium distance fibre module LEDs .....	68
Figure A.56 – Long and extra long repeater module LEDs .....	69
Figure B.1 – Interconnection of CPF 2 networks .....	73
Figure B.2 – Redundant linear bus .....	74
Figure B.18 – Example of combination of basic active topologies .....	75
Figure B.3 – Peer-to-peer connections .....	75
Figure B.4 – Mated connections .....	78
Figure B.5 – The 8-way modular sealed jack & plug (plastic housing) .....	87
Figure B.6 – The 8-way modular sealed jack & plug (metal housing) .....	87
Figure B.7 – M12-4 connectors .....	88
Figure B.8 – Example of a metallic shell M12-8 X-coding connectors .....	89
Figure B.9 – Simplex LC connector .....	90
Figure B.10 – Duplex LC connector .....	90
Figure B.11 – IP65/67 sealed duplex LC connector .....	90
Figure B.12 – IP65/67 sealed duplex SC-RJ connector .....	91
Figure B.13 – M12-4 to 8-way modular bulkhead .....	93
Figure B.19 – Shield termination in star earthing arrangements .....	95
Figure B.20 – Shield termination in mesh earthing arrangements .....	95
Figure B.14 – The 8-way modular sealed jack & plug (plastic housing) .....	99

Figure B.15 – The 8-way modular sealed jack & plug (metal housing) ..... 99

Figure B.16 – M12-4 connectors ..... 99

Figure B.17 – Earthing of cable shield ..... 101

Figure C.1 – Interconnection of CPF 2 networks ..... 107

Figure C.2 – Connection to generic cabling..... 108

Figure C.3 – DeviceNet cable system uses a trunk/drop line topology..... 110

Figure C.4 – Measuring the trunk length ..... 112

Figure C.5 – Measuring the trunk and drop length..... 112

Figure C.6 – Measuring drop cable in a network with multiports ..... 113

Figure C.7 – Removable device using open-style connectors ..... 113

Figure C.8 – Fixed connection using open-style connector..... 114

Figure C.9 – Open-style connector pin out ..... 114

Figure C.10 – Open-style connector pin out 10 position ..... 114

Figure C.11 – Power Bus Current derate as a function of temperature differential..... 117

Figure C.12 – Power supply sizing example ..... 118

Figure C.13 – Current limit for thick cable for one power supply ..... 119

Figure C.14 – Example of a continuous power bus..... 120

Figure C.15 – Current limit for thick cable and two power supplies common V+ ..... 121

Figure C.16 – Worst-case scenario ..... 122

Figure C.17 – Example using the lookup method ..... 122

Figure C.18 – One power supply end connected ..... 124

Figure C.19 – Segmenting power in the power bus ..... 125

Figure C.20 – Segmenting the power bus using power taps ..... 125

Figure C.21 – Thick cable construction ..... 136

Figure C.22 – Cable Type I construction ..... 136

Figure C.23 – Thin cable construction ..... 137

Figure C.24 – Flat cable construction..... 137

Figure C.25 – Cable preparation ..... 138

Figure C.26 – Connector assembly ..... 138

Figure C.28 – M12 connector pin assignment ..... 139

Figure C.29 – Mini connector pin assignment..... 139

Figure C.30 – Preparation of cable end..... 140

Figure C.31 – Shrink wrap installation..... 140

Figure C.32 – Wire preparation ..... 140

Figure C.33 – Open-style connector (female)..... 141

Figure C.34 – Open-style (male plug) ..... 141

Figure C.35 – Flat cable..... 142

Figure C.36 – Aligning the cable ..... 142

Figure C.37 – Closing the assembly..... 143

Figure C.38 – Proper orientation of cable..... 143

Figure C.39 – Locking the assembly ..... 143

Figure C.40 – Driving the IDC contacts in to the cable ..... 144

Figure C.41 – End cap placement ..... 144

Figure C.42 – End cap seated.....	145
Figure C.43 – End cap installation on alternate side of cable .....	145
Figure C.44 – Flat cable IDC connectors.....	146
Figure C.45 – Installing the connectors .....	146
Figure C.46 – Cable wiring to open-style terminals .....	147
Figure C.47 – Auxiliary power cable profile .....	147
Figure C.48 – Pin out auxiliary power connectors.....	148
Figure C.49 – Power supply cable length versus wire size .....	149
Figure C.50 – Sealed terminator .....	151
Figure C.51 – Open-style terminator .....	151
Figure C.52 – Open-style IDC terminator .....	151
Figure C.53 – Sealed terminator IDC cable .....	152
Figure C.54 – Direct connection to the trunk .....	153
Figure C.55 – Wiring of open-style connector.....	153
Figure C.56 – Wiring of open-style 10-position connector .....	153
Figure C.57 – Diagnostic temporary connections .....	154
Figure C.58 – Thick cable preterminated cables (cord sets).....	155
Figure C.59 – Thin cable preterminated cables (cord sets).....	155
Table A.1 – Basic network characteristics for balanced cabling not based on Ethernet .....	25
Table A.2 – Network characteristics for optical fibre cabling.....	26
Table A.3 – RG6 coaxial electrical properties.....	28
Table A.4 – RG6 coaxial physical parameters .....	28
Table A.5 – Cable type selection.....	29
Table A.6 – Information relevant to optical fibre cables .....	30
Table A.7 – Copper connectors for ControlNet.....	31
Table A.8 – Optical fibre connecting hardware .....	31
Table A.9 – Relationship between FOC and fibre types (CP 2/1).....	32
Table A.10 – Parameters for coaxial RG6 cables .....	46
Table A.11 – Bend radius for coaxial cables outside conduit .....	46
Table A.12 – Parameters for silica optical fibre cables .....	46
Table A.13 – Parameters for hard clad silica optical fibre.....	47
Table A.14 – Test matrix for BNC/TNC connectors.....	62
Table A.15 – Wavelength and fibre types .....	65
Table A.16 – LED status table.....	67
Table A.17 – Repeater adapter and module diagnostic .....	67
Table A.18 – Repeater adapter indicator diagnostic .....	67
Table A.19 – Repeater module indicator .....	68
Table A.20 – Short and medium distance troubleshooting chart .....	69
Table A.21 – Long and extra long troubleshooting chart.....	70
Table B.1 – Network characteristics for balanced cabling based on Ethernet .....	76
Table B.2 – Network characteristics for optical fibre cabling.....	77
Table B.3 – Fibre lengths for 1 mm POF A4a.2 POF 0.5 NA .....	77

Table B.4 – Fibre lengths for 1 mm POF A4d POF 0.3 NA .....	78
Table B.5 – Recognized fibre types.....	79
Table B.6 – Recognized fibre PMDs.....	79
Table B.7 – Information relevant to copper cable: fixed cables 10/100 MHz .....	80
Table B.8 – Information relevant to copper cable: fixed cables 1 000 MHz .....	81
Table B.9 – Information relevant to copper cable: cords 10/100 MHz .....	81
<del>Table B.10 – TCL limits for unshielded twisted-pair cabling serving 10/100 Mb/s .....</del>	
<del>Table B.11 – TCL limits for unshielded twisted-pair cabling serving 1 000 Mb/s .....</del>	
<del>Table B.12 – ELTCTL limits for unshielded twisted-pair cabling serving 10/100 Mb/s .....</del>	
<del>Table B.13 – ELTCTL limits for unshielded twisted-pair cabling serving 1 000 Mb/s .....</del>	
<del>Table B.14 – Coupling attenuation limits for screened twisted-pair cabling.....</del>	
Table B.27 – Unbalance attenuation limits for unshielded twisted-pair cabling serving 10BASE-T and 100BASE-T applications .....	84
Table B.28 – Unbalance attenuation limits for unshielded twisted-pair cabling serving 1000BASE-T applications with enhanced components .....	84
Table B.29 – Unbalance attenuation limits for unshielded twisted-pair cabling serving 1000BASE-T applications with length derating .....	85
Table B.30 – Coupling attenuation limits for screened twisted-pair cabling.....	85
Table B.15 – Information relevant to optical fibre cables .....	85
Table B.16 – Connectors for balanced cabling CPs based on Ethernet .....	86
<del>Table B.17 – TCL limits for connectors based on Ethernet serving 1 000 Mb/s.....</del>	
Table B.17 – Unbalance Attenuation limits for connectors based on Ethernet serving 1000BASE-T applications .....	87
Table B.18 – Industrial EtherNet/IP 8-way modular connector parameters .....	87
Table B.19 – Industrial EtherNet/IP M12-4 D-coding connector parameters .....	88
Table B.20 – Industrial EtherNet/IP M12-8 X-coding connector parameters.....	89
Table B.21 – Optical fibre connecting hardware .....	90
Table B.22 – Relationship between FOC and fibre types (CP2/2).....	91
Table B.23 – Connector insertion loss.....	91
Table B.24 – Parameters for balanced cables .....	98
Table B.25 – Parameters for silica optical fibre cables .....	98
Table B.26 – Parameters for POF optical fibre cables .....	98
Table C.1 – Basic network characteristics for copper cabling not based on Ethernet.....	110
Table C.2 – Cable trunk and drop lengths for CP 2/3 .....	111
Table C.3 – Summary of available current for trunk cables (CP 2/3).....	115
Table C.4 – Permissible current for thin cable drop lines of various lengths .....	116
Table C.5 – Power supply specification for DeviceNet.....	116
Table C.6 – Power supply tolerance stack up for DeviceNet.....	117
Table C.7 – Current versus cable length for one power supply thick cable .....	120
Table C.8 – Current versus length for two power supplies.....	121
Table C.9 – Definition of equation variables .....	123
Table C.10 – Information relevant to copper cable: fixed cables.....	126
Table C.11 – Information relevant to copper cable: cords.....	126
Table C.12 – DeviceNet cables and connector support cross reference .....	127



Table C.13 – DeviceNet cable profiles .....	128
Table C.14 – Copper connectors for non-Ethernet based fieldbus .....	130
Table C.15 – Additional connectors for CP 2/3 (DeviceNet) .....	130
Table C.16 – Parameters for balanced cables.....	135
Table C.17 – Wire colour code and function.....	141
Table C.18 – Auxiliary power cable colour code .....	147
Table C.19 – Auxiliary power supply requirements .....	148
Table C.20 – Signal wire verification .....	158
Table C.21 – Shield to earth .....	158
Table C.22 – Connector pin out .....	160

## INTERNATIONAL ELECTROTECHNICAL COMMISSION

---

**INDUSTRIAL COMMUNICATION NETWORKS –  
PROFILES –****Part 5-2: Installation of fieldbuses –  
Installation profiles for CPF 2****FOREWORD**

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) IEC draws attention to the possibility that the implementation of this document may involve the use of (a) patent(s). IEC takes no position concerning the evidence, validity or applicability of any claimed patent rights in respect thereof. As of the date of publication of this document, IEC had not received notice of (a) patent(s), which may be required to implement this document. However, implementers are cautioned that this may not represent the latest information, which may be obtained from the patent database available at <https://patents.iec.ch>. IEC shall not be held responsible for identifying any or all such patent rights.

**This consolidated version of the official IEC Standard and its amendment has been prepared for user convenience.**

**IEC 61784-5-2 edition 4.1 contains the fourth edition (2018-08) [documents 65C/924/FDIS and 65C/925/RVD] and its amendment 1 (2024-03) [documents 65C/1283/FDIS and 65C/1297/RVD].**

**In this Redline version, a vertical line in the margin shows where the technical content is modified by amendment 1. Additions are in green text, deletions are in strikethrough red text. A separate Final version with all changes accepted is available in this publication.**

International Standard IEC 61784-5-2 has been prepared by subcommittee 65C: Industrial networks, of IEC technical committee 65: Industrial-process measurement, control and automation.

This document is to be used in conjunction with IEC 61918:2018, IEC 61918:2018/AMD1:2022 and IEC 61918:2018/AMD2:2024.

This fourth edition cancels and replaces the third edition published in 2013. This edition constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

- a) references to ISO/IEC 24702 have been replaced with references to ISO/IEC 11801-3 in Table B.1;
- b) errors have been corrected;
- c) Tables B11 and B13 have been added in support of 1,000 Mb/s 4 Pair Ethernet;
- d) Clarification of dual power supplies for Annex C.

~~This standard is to be used in conjunction with IEC 61918:2018.~~

This document has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts of IEC 61784-5 series, under the general title *Industrial communication networks – Profiles – Installation of fieldbuses*, can be found on the IEC website.

The committee has decided that the contents of this document and its amendment will remain unchanged until the stability date indicated on the IEC website under [webstore.iec.ch](http://webstore.iec.ch) in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn, or
- revised.

**IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.**

## INTRODUCTION

This ~~International Standard~~ document is one of a series produced to facilitate the use of communication networks in industrial control systems.

IEC 61918:2018, IEC 61918:2018/AMD1:2022 and IEC 61918:2018/AMD2:2024 provides the common requirements for the installation of communication networks in industrial control systems. This installation profile standard provides the installation profiles of the communication profiles (CP) of a specific communication profile family (CPF) by stating which requirements of IEC 61918 fully apply and, where necessary, by supplementing, modifying, or replacing the other requirements (see Figure 1).

For general background on fieldbuses, their profiles, and relationship between the installation profiles specified in this document, see IEC 61158-1.

Each CP installation profile is specified in a separate annex of this document. Each annex is structured exactly as the reference standard IEC 61918 for the benefit of the persons representing the roles in the fieldbus installation process as defined in IEC 61918 (planner, installer, verification personnel, validation personnel, maintenance personnel, administration personnel). By reading the installation profile in conjunction with IEC 61918, these persons immediately know which requirements are common for the installation of all CPs and which are modified or replaced. The conventions used to draft this document are defined in Clause 5.

The provision of the installation profiles in one standard for each CPF (for example IEC 61784-5-2 for CPF 2) allows readers to work with standards of a convenient size.

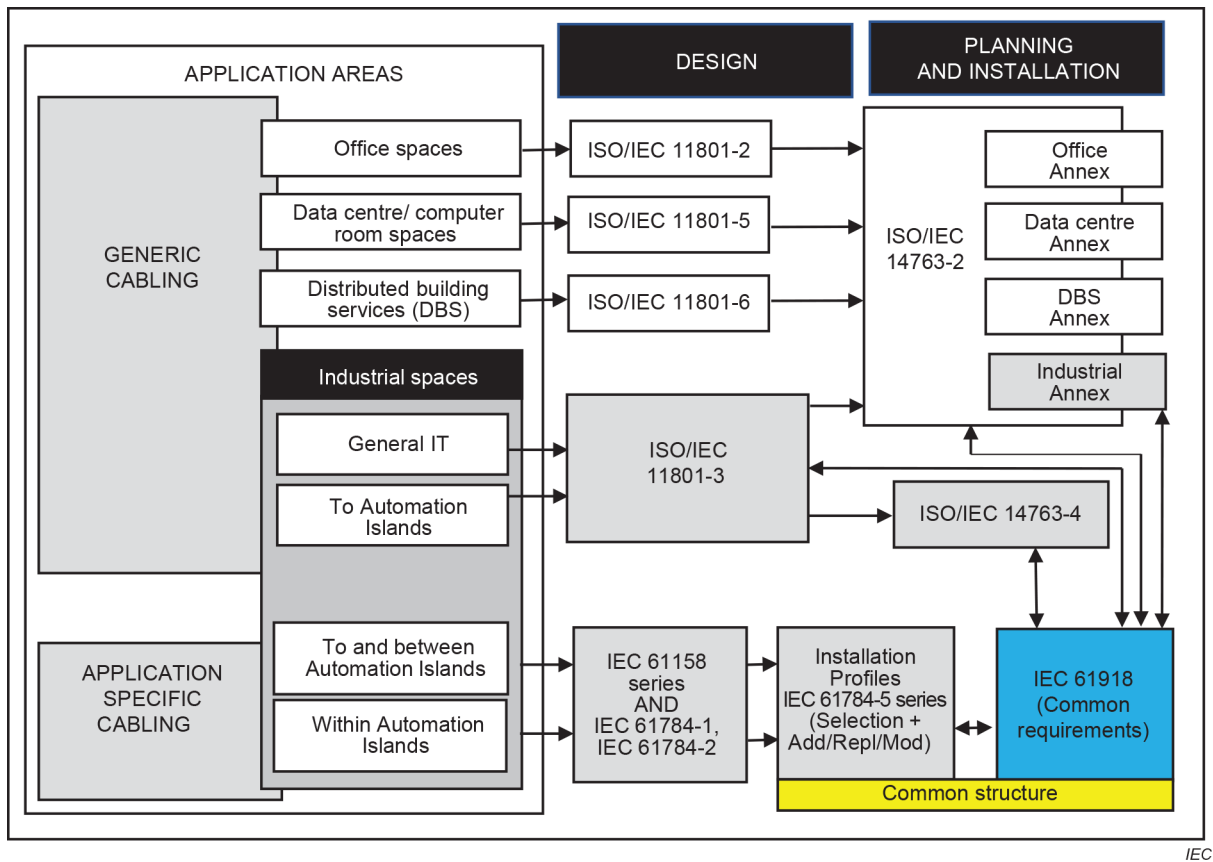
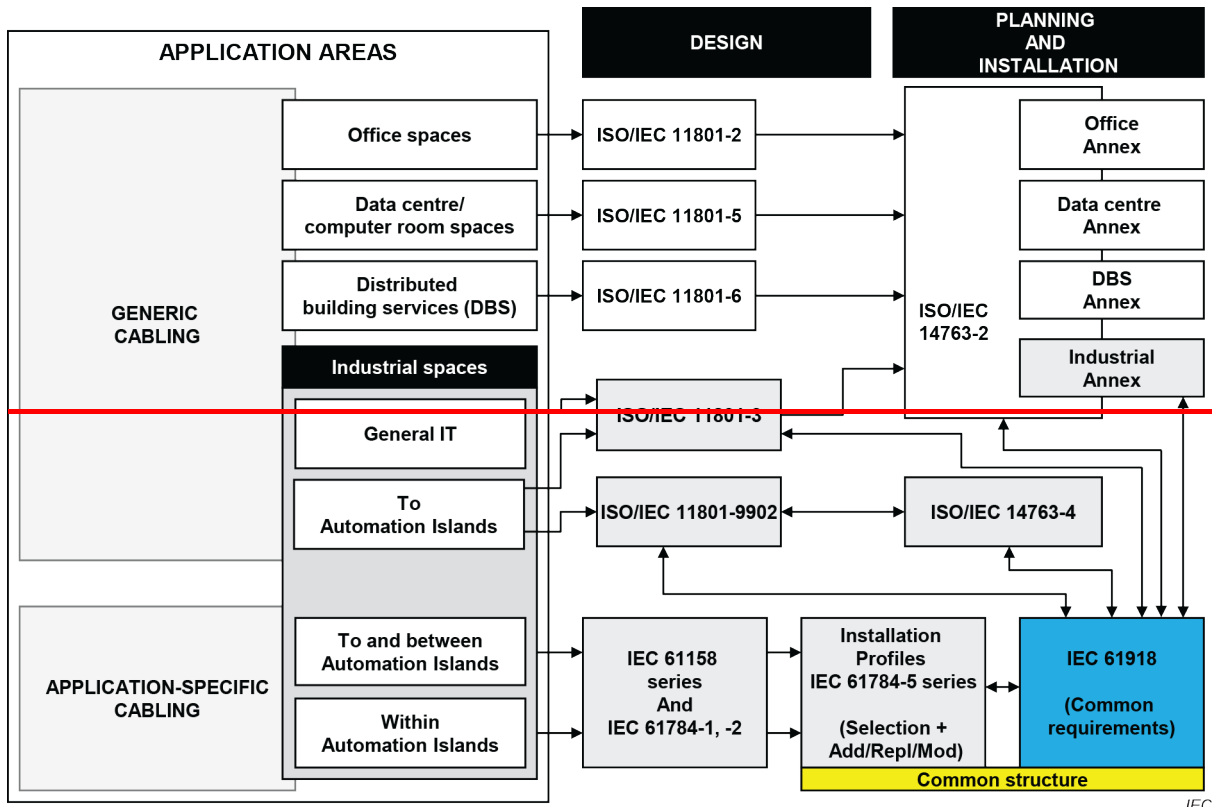


Figure 1 – Standards relationships

## INTRODUCTION to Amendment 1

This Amendment 1 includes the following significant technical changes with respect to IEC 61784-5-2:2018:

- a) Updated references of IEC 61918:2018 to include additions of IEC 61918:2018/AMD1:2022 and IEC 61918:2018/AMD2:2024,
- b) Added references for consideration of security to Subclause B.4.2.2,
- c) Updated optical fiber specifications and references in Subclauses B.4.3.3.2 and B.4.4.1.4,
- d) Added definition of electromagnetic compatibility options for conformance to Subclause B.4.4.1.2.1,
- e) Added support of mesh bonding systems to Subclause B.4.4 and Clause B.5,
- f) Added acceptance of end-to-end link verification and certification testing to Clause B.6.

## INDUSTRIAL COMMUNICATION NETWORKS – PROFILES –

### Part 5-2: Installation of fieldbuses – Installation profiles for CPF 2

#### 1 Scope

This part of IEC 61784-5 specifies the installation profiles for CPF 2 (CIP™<sup>1</sup>).

The installation profiles are specified in the annexes. These annexes are read in conjunction with IEC 61918:2018, IEC 61918:2018/AMD1:2022 and IEC 61918:2018/AMD2:2024.

#### 2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 61918:2018<sup>2</sup>, *Industrial communication networks – Installation of communication networks in industrial premises*

IEC 61918:2018/AMD1:2022

IEC 61918:2018/AMD2:2024

~~The normative references of IEC 61918:2018, Clause 2, apply.~~

NOTE For profile specific normative references, see Clauses A.2, B.2, and C.2.

---

<sup>1</sup> CIP™ (Common Industrial Protocol) is a trade name of ODVA, Inc. This information is given for the convenience of users of this International Standard and does not constitute an endorsement by IEC of the trademark holder or any of its products. Compliance to this document does not require use of the trade name CIP™. Use of the trade name CIP™ requires permission of ODVA, Inc.

<sup>2</sup> The normative references of IEC 61918:2018, Clause 2, IEC 61918:2018/AMD1:2022, Clause 2 and IEC 61918:2018/AMD2:2024, Clause 2, apply.

CONTENTS

- FOREWORD..... 10
- INTRODUCTION..... 12
- INTRODUCTION to Amendment 1 ..... 13
- 1 Scope..... 14
- 2 Normative references ..... 14
- 3 Terms, definitions and abbreviated terms ..... 14
- 4 CPF 2: Overview of installation profiles ..... 14
- 5 Installation profile conventions ..... 15
- 6 Conformance to installation profiles..... 16
- Annex A (normative) CP 2/1 (ControlNet™) specific installation profile ..... 17
  - A.1 Installation profile scope ..... 17
  - A.2 Normative references..... 17
  - A.3 Installation profile terms, definitions, and abbreviated terms ..... 17
    - A.3.1 Terms and definitions ..... 17
    - A.3.2 Abbreviated terms ..... 17
    - A.3.3 Conventions for installation profiles ..... 17
  - A.4 Installation planning..... 18
    - A.4.1 General ..... 18
    - A.4.2 Planning requirements ..... 19
    - A.4.3 Network capabilities..... 20
    - A.4.4 Selection and use of cabling components ..... 26
    - A.4.5 Cabling planning documentation ..... 44
    - A.4.6 Verification of cabling planning specification..... 44
  - A.5 Installation implementation ..... 44
    - A.5.1 General requirements ..... 44
    - A.5.2 Cable installation ..... 44
    - A.5.3 Connector installation ..... 46
    - A.5.4 Terminator installation ..... 55
    - A.5.5 Device installation ..... 55
    - A.5.6 Coding and labelling ..... 57
    - A.5.7 Earthing and bonding of equipment and devices and shield cabling ..... 58
    - A.5.8 As-implemented cabling documentation ..... 59
  - A.6 Installation verification and installation acceptance test ..... 59
    - A.6.1 General ..... 59
    - A.6.2 Installation verification ..... 59
    - A.6.3 Installation acceptance test ..... 62
  - A.7 Installation administration ..... 64
  - A.8 Installation maintenance and installation troubleshooting ..... 64
    - A.8.1 General ..... 64
    - A.8.2 Maintenance ..... 64
    - A.8.3 Troubleshooting..... 64
    - A.8.4 Specific requirements for maintenance and troubleshooting..... 69
- Annex B (normative) CP 2/2 (EtherNet/IP™) specific installation profile..... 70
  - B.1 Installation profile scope ..... 70
  - B.2 Normative references..... 70
  - B.3 Installation profile terms, definitions, and abbreviated terms ..... 71



B.3.1	Terms and definitions .....	71
B.3.2	Abbreviated terms .....	71
B.3.3	Conventions for installation profiles .....	71
B.4	Installation planning .....	71
B.4.1	General .....	71
B.4.2	Planning requirements .....	72
B.4.3	Network capabilities .....	73
B.4.4	Selection and use of cabling components .....	79
B.4.5	Cabling planning documentation .....	94
B.4.6	Verification of cabling planning specification .....	94
B.5	Installation implementation .....	94
B.5.1	General requirements .....	94
B.5.2	Cable installation .....	94
B.5.3	Connector installation .....	95
B.5.4	Terminator installation .....	97
B.5.5	Device installation .....	97
B.5.6	Coding and labelling .....	97
B.5.7	Earthing and bonding of equipment and devices and shield cabling .....	97
B.5.8	As-implemented cabling documentation .....	99
B.6	Installation verification and installation acceptance test .....	99
B.6.1	General .....	99
B.6.2	Installation verification .....	99
B.6.3	Installation acceptance test .....	100
B.7	Installation administration .....	101
B.8	Installation maintenance and installation troubleshooting .....	101
Annex C (normative)	CP 2/3 (DeviceNet™) specific installation profile .....	102
C.1	Installation profile scope .....	102
C.2	Normative references .....	102
C.3	Installation profile terms, definitions, and abbreviated terms .....	102
C.3.1	Terms and definitions .....	102
C.3.2	Abbreviated terms .....	102
C.3.3	Conventions for installation profiles .....	102
C.4	Installation planning .....	103
C.4.1	General .....	103
C.4.2	Planning requirements .....	104
C.4.3	Network capabilities .....	105
C.4.4	Selection and use of cabling components .....	121
C.4.5	Cabling planning documentation .....	131
C.4.6	Verification of cabling planning specification .....	131
C.5	Installation implementation .....	131
C.5.1	General requirements .....	131
C.5.2	Cable installation .....	131
C.5.3	Connector installation .....	133
C.5.4	Terminator installation .....	146
C.5.5	Device installation .....	148
C.5.6	Coding and labelling .....	152
C.5.7	Earthing and bonding of equipment and devices and shield cabling .....	152
C.5.8	As-implemented cabling documentation .....	153
C.6	Installation verification and installation acceptance test .....	153

- C.6.1 General ..... 153
- C.6.2 Installation verification ..... 153
- C.6.3 Installation acceptance test ..... 156
- C.7 Installation administration ..... 157
- C.8 Installation maintenance and installation troubleshooting ..... 157
  - C.8.1 General ..... 157
  - C.8.2 Maintenance ..... 157
  - C.8.3 Troubleshooting ..... 157
  - C.8.4 Specific requirements for maintenance and troubleshooting ..... 157
- Annex D (informative) Additional information ..... 161
  - D.1 Network validation check sheet for CP 2/3 (DeviceNet) ..... 161
- Bibliography ..... 165

- Figure 1 – Standards relationships ..... 12
- Figure A.1 – Interconnection of CPF 2 networks ..... 18
- Figure A.2 – Overview of CPF 2/1 networks ..... 19
- Figure A.3 – Drop cable requirements ..... 21
- Figure A.4 – Placement of BNC/TNC plugs ..... 21
- Figure A.5 – Placement of terminators ..... 22
- Figure A.6 – Extending a network using repeaters ..... 22
- Figure A.7 – Extending a network using active star topology ..... 22
- Figure A.8 – Links ..... 23
- Figure A.9 – Extending the network beyond 99 nodes ..... 23
- Figure A.10 – Maximum allowable taps per segment ..... 32
- Figure A.11 – Example of repeaters in star configuration ..... 33
- Figure A.12 – Repeater in parallel ..... 34
- Figure A.13 – Repeater in combination series and parallel ..... 35
- Figure A.14 – Ring repeater ..... 35
- Figure A.15 – Installing bulkheads ..... 36
- Figure A.16 – Coaxial BNC and TNC terminators ..... 37
- Figure A.17 – Terminator placement in a segment ..... 37
- Figure A.18 – RC Shield Termination in Active Devices ..... 39
- Figure A.19 – Redundant network icons ..... 40
- Figure A.20 – Redundant coax media ..... 40
- Figure A.21 – Redundant fibre media ..... 40
- Figure A.22 – Repeater in series versus length difference for coax media ..... 41
- Figure A.23 – Repeater in series versus length difference for fibre media ..... 42
- Figure A.24 – Example of redundant coax network with repeaters ..... 42
- Figure A.25 – Example of improper redundant node connection ..... 43
- Figure A.26 – Example tool kit for installing BNC connectors ..... 47
- Figure A.27 – Calibration of coaxial stripper ..... 47
- Figure A.28 – Coax PVC strip length detail (informative) ..... 48
- Figure A.29 – Memory cartridge and blade ..... 49
- Figure A.30 – Cable position ..... 49

Figure A.31 – Locking the cable	49
Figure A.32 – Stripping the cable	50
Figure A.33 – Install the crimp ferrule	50
Figure A.34 – Cable preparation for PVC type cables (informative)	51
Figure A.35 – Cable preparation for FEP type cables (informative)	51
Figure A.36 – Strip guides	51
Figure A.37 – Using the flare tool	52
Figure A.38 – Expanding the shields	52
Figure A.39 – Install the centre pin	52
Figure A.40 – Crimping the centre pin	53
Figure A.41 – Installing the connector body	53
Figure A.42 – Installing the ferrule	53
Figure A.43 – Crimp tool	54
Figure A.44 – Sealed IP65/67 cable	55
Figure A.45 – Terminator placement	55
Figure A.46 – Mounting the taps	56
Figure A.47 – Mounting the tap assembly using the universal mounting bracket	57
Figure A.48 – Mounting the tap using tie wraps or screws	57
Figure A.49 – Redundant network icons	58
Figure A.50 – Network test tool	60
Figure A.51 – Shorting the cable to test for continuity	61
Figure A.52 – Testing fibre segments	63
Figure A.53 – Multi-fibre backbone cable housing	65
Figure A.54 – Repeater adapter module	65
Figure A.55 – Short and medium distance fibre module LEDs	67
Figure A.56 – Long and extra long repeater module LEDs	68
Figure B.1 – Interconnection of CPF 2 networks	72
Figure B.2 – Redundant linear bus	73
Figure B.18 – Example of combination of basic active topologies	74
Figure B.3 – Peer-to-peer connections	74
Figure B.4 – Mated connections	77
Figure B.5 – The 8-way modular sealed jack & plug (plastic housing)	84
Figure B.6 – The 8-way modular sealed jack & plug (metal housing)	84
Figure B.7 – M12-4 connectors	85
Figure B.8 – Example of a metallic shell M12-8 X-coding connectors	86
Figure B.9 – Simplex LC connector	87
Figure B.10 – Duplex LC connector	87
Figure B.11 – IP65/67 sealed duplex LC connector	87
Figure B.12 – IP65/67 sealed duplex SC-RJ connector	88
Figure B.13 – M12-4 to 8-way modular bulkhead	90
Figure B.19 – Shield termination in star earthing arrangements	92
Figure B.20 – Shield termination in mesh earthing arrangements	92
Figure B.14 – The 8-way modular sealed jack & plug (plastic housing)	96

Figure B.15 – The 8-way modular sealed jack & plug (metal housing) ..... 96

Figure B.16 – M12-4 connectors ..... 96

Figure B.17 – Earthing of cable shield ..... 98

Figure C.1 – Interconnection of CPF 2 networks ..... 103

Figure C.2 – Connection to generic cabling..... 104

Figure C.3 – DeviceNet cable system uses a trunk/drop line topology..... 106

Figure C.4 – Measuring the trunk length ..... 108

Figure C.5 – Measuring the trunk and drop length..... 108

Figure C.6 – Measuring drop cable in a network with multiports ..... 109

Figure C.7 – Removable device using open-style connectors ..... 109

Figure C.8 – Fixed connection using open-style connector..... 110

Figure C.9 – Open-style connector pin out ..... 110

Figure C.10 – Open-style connector pin out 10 position ..... 110

Figure C.11 – Power Bus Current derate as a function of temperature differential..... 113

Figure C.12 – Power supply sizing example ..... 114

Figure C.13 – Current limit for thick cable for one power supply ..... 115

Figure C.14 – Example of a continuous power bus..... 116

Figure C.15 – Current limit for thick cable and two power supplies common V+ ..... 117

Figure C.16 – Worst-case scenario ..... 118

Figure C.17 – Example using the lookup method ..... 118

Figure C.18 – One power supply end connected ..... 120

Figure C.19 – Segmenting power in the power bus ..... 121

Figure C.20 – Segmenting the power bus using power taps ..... 121

Figure C.21 – Thick cable construction ..... 132

Figure C.22 – Cable Type I construction ..... 132

Figure C.23 – Thin cable construction ..... 133

Figure C.24 – Flat cable construction..... 133

Figure C.25 – Cable preparation ..... 134

Figure C.26 – Connector assembly ..... 134

Figure C.28 – M12 connector pin assignment ..... 135

Figure C.29 – Mini connector pin assignment..... 135

Figure C.30 – Preparation of cable end..... 136

Figure C.31 – Shrink wrap installation..... 136

Figure C.32 – Wire preparation ..... 136

Figure C.33 – Open-style connector (female)..... 137

Figure C.34 – Open-style (male plug) ..... 137

Figure C.35 – Flat cable..... 138

Figure C.36 – Aligning the cable ..... 138

Figure C.37 – Closing the assembly..... 139

Figure C.38 – Proper orientation of cable..... 139

Figure C.39 – Locking the assembly ..... 139

Figure C.40 – Driving the IDC contacts in to the cable ..... 140

Figure C.41 – End cap placement ..... 140

Figure C.42 – End cap seated.....	141
Figure C.43 – End cap installation on alternate side of cable .....	141
Figure C.44 – Flat cable IDC connectors.....	142
Figure C.45 – Installing the connectors .....	142
Figure C.46 – Cable wiring to open-style terminals .....	143
Figure C.47 – Auxiliary power cable profile .....	143
Figure C.48 – Pin out auxiliary power connectors.....	144
Figure C.49 – Power supply cable length versus wire size .....	145
Figure C.50 – Sealed terminator .....	147
Figure C.51 – Open-style terminator .....	147
Figure C.52 – Open-style IDC terminator .....	147
Figure C.53 – Sealed terminator IDC cable .....	148
Figure C.54 – Direct connection to the trunk .....	149
Figure C.55 – Wiring of open-style connector.....	149
Figure C.56 – Wiring of open-style 10-position connector .....	149
Figure C.57 – Diagnostic temporary connections .....	150
Figure C.58 – Thick cable preterminated cables (cord sets).....	151
Figure C.59 – Thin cable preterminated cables (cord sets).....	151
Table A.1 – Basic network characteristics for balanced cabling not based on Ethernet .....	24
Table A.2 – Network characteristics for optical fibre cabling.....	25
Table A.3 – RG6 coaxial electrical properties.....	27
Table A.4 – RG6 coaxial physical parameters .....	27
Table A.5 – Cable type selection.....	28
Table A.6 – Information relevant to optical fibre cables .....	29
Table A.7 – Copper connectors for ControlNet.....	30
Table A.8 – Optical fibre connecting hardware .....	30
Table A.9 – Relationship between FOC and fibre types (CP 2/1).....	31
Table A.10 – Parameters for coaxial RG6 cables .....	45
Table A.11 – Bend radius for coaxial cables outside conduit .....	45
Table A.12 – Parameters for silica optical fibre cables .....	45
Table A.13 – Parameters for hard clad silica optical fibre.....	46
Table A.14 – Test matrix for BNC/TNC connectors.....	61
Table A.15 – Wavelength and fibre types .....	64
Table A.16 – LED status table.....	66
Table A.17 – Repeater adapter and module diagnostic .....	66
Table A.18 – Repeater adapter indicator diagnostic .....	66
Table A.19 – Repeater module indicator .....	67
Table A.20 – Short and medium distance troubleshooting chart .....	68
Table A.21 – Long and extra long troubleshooting chart.....	69
Table B.1 – Network characteristics for balanced cabling based on Ethernet .....	75
Table B.2 – Network characteristics for optical fibre cabling.....	76
Table B.3 – Fibre lengths for 1 mm POF A4a.2 POF 0.5 NA .....	76

Table B.4 – Fibre lengths for 1 mm POF A4d POF 0.3 NA .....	77
Table B.5 – Recognized fibre types.....	78
Table B.6 – Recognized fibre PMDs.....	78
Table B.7 – Information relevant to copper cable: fixed cables 10/100 MHz .....	79
Table B.8 – Information relevant to copper cable: fixed cables 1 000 MHz .....	80
Table B.9 – Information relevant to copper cable: cords 10/100 MHz .....	80
Table B.27 – Unbalance attenuation limits for unshielded twisted-pair cabling serving 10BASE-T and 100BASE-T applications .....	81
Table B.28 – Unbalance attenuation limits for unshielded twisted-pair cabling serving 1000BASE-T applications with enhanced components .....	81
Table B.29 – Unbalance attenuation limits for unshielded twisted-pair cabling serving 1000BASE-T applications with length derating .....	82
Table B.30 – Coupling attenuation limits for screened twisted-pair cabling.....	82
Table B.15 – Information relevant to optical fibre cables .....	82
Table B.16 – Connectors for balanced cabling CPs based on Ethernet .....	83
Table B.17 – Unbalance Attenuation limits for connectors based on Ethernet serving 1000BASE-T applications .....	83
Table B.18 – Industrial EtherNet/IP 8-way modular connector parameters .....	84
Table B.19 – Industrial EtherNet/IP M12-4 D-coding connector parameters .....	85
Table B.20 – Industrial EtherNet/IP M12-8 X-coding connector parameters.....	86
Table B.21 – Optical fibre connecting hardware .....	87
Table B.22 – Relationship between FOC and fibre types (CP2/2).....	88
Table B.23 – Connector insertion loss.....	88
Table B.24 – Parameters for balanced cables .....	95
Table B.25 – Parameters for silica optical fibre cables .....	95
Table B.26 – Parameters for POF optical fibre cables .....	95
Table C.1 – Basic network characteristics for copper cabling not based on Ethernet.....	106
Table C.2 – Cable trunk and drop lengths for CP 2/3 .....	107
Table C.3 – Summary of available current for trunk cables (CP 2/3).....	111
Table C.4 – Permissible current for thin cable drop lines of various lengths .....	112
Table C.5 – Power supply specification for DeviceNet.....	112
Table C.6 – Power supply tolerance stack up for DeviceNet.....	113
Table C.7 – Current versus cable length for one power supply thick cable .....	116
Table C.8 – Current versus length for two power supplies.....	117
Table C.9 – Definition of equation variables .....	119
Table C.10 – Information relevant to copper cable: fixed cables .....	122
Table C.11 – Information relevant to copper cable: cords.....	122
Table C.12 – DeviceNet cables and connector support cross reference .....	123
Table C.13 – DeviceNet cable profiles .....	124
Table C.14 – Copper connectors for non-Ethernet based fieldbus .....	126
Table C.15 – Additional connectors for CP 2/3 (DeviceNet) .....	126
Table C.16 – Parameters for balanced cables.....	131
Table C.17 – Wire colour code and function.....	137
Table C.18 – Auxiliary power cable colour code .....	143

Table C.19 – Auxiliary power supply requirements .....	144
Table C.20 – Signal wire verification .....	154
Table C.21 – Shield to earth .....	154
Table C.22 – Connector pin out .....	156

## INTERNATIONAL ELECTROTECHNICAL COMMISSION

---

**INDUSTRIAL COMMUNICATION NETWORKS –  
PROFILES –****Part 5-2: Installation of fieldbuses –  
Installation profiles for CPF 2**

## FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) IEC draws attention to the possibility that the implementation of this document may involve the use of (a) patent(s). IEC takes no position concerning the evidence, validity or applicability of any claimed patent rights in respect thereof. As of the date of publication of this document, IEC had not received notice of (a) patent(s), which may be required to implement this document. However, implementers are cautioned that this may not represent the latest information, which may be obtained from the patent database available at <https://patents.iec.ch>. IEC shall not be held responsible for identifying any or all such patent rights.

**This consolidated version of the official IEC Standard and its amendment has been prepared for user convenience.**

**IEC 61784-5-2 edition 4.1 contains the fourth edition (2018-08) [documents 65C/924/FDIS and 65C/925/RVD] and its amendment 1 (2024-03) [documents 65C/1283/FDIS and 65C/1297/RVD].**

**This Final version does not show where the technical content is modified by amendment 1. A separate Redline version with all changes highlighted is available in this publication.**



International Standard IEC 61784-5-2 has been prepared by subcommittee 65C: Industrial networks, of IEC technical committee 65: Industrial-process measurement, control and automation.

This document is to be used in conjunction with IEC 61918:2018, IEC 61918:2018/AMD1:2022 and IEC 61918:2018/AMD2:2024.

This fourth edition cancels and replaces the third edition published in 2013. This edition constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

- a) references to ISO/IEC 24702 have been replaced with references to ISO/IEC 11801-3 in Table B.1;
- b) errors have been corrected;
- c) Tables B11 and B13 have been added in support of 1,000 Mb/s 4 Pair Ethernet;
- d) Clarification of dual power supplies for Annex C.

This document has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts of IEC 61784-5 series, under the general title *Industrial communication networks – Profiles – Installation of fieldbuses*, can be found on the IEC website.

The committee has decided that the contents of this document and its amendment will remain unchanged until the stability date indicated on the IEC website under [webstore.iec.ch](http://webstore.iec.ch) in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn, or
- revised.

**IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.**

## INTRODUCTION


This document is one of a series produced to facilitate the use of communication networks in industrial control systems.

IEC 61918:2018, IEC 61918:2018/AMD1:2022 and IEC 61918:2018/AMD2:2024 provide the common requirements for the installation of communication networks in industrial control systems. This installation profile standard provides the installation profiles of the communication profiles (CP) of a specific communication profile family (CPF) by stating which requirements of IEC 61918 fully apply and, where necessary, by supplementing, modifying, or replacing the other requirements (see Figure 1).

For general background on fieldbuses, their profiles, and relationship between the installation profiles specified in this document, see IEC 61158-1.

Each CP installation profile is specified in a separate annex of this document. Each annex is structured exactly as the reference standard IEC 61918 for the benefit of the persons representing the roles in the fieldbus installation process as defined in IEC 61918 (planner, installer, verification personnel, validation personnel, maintenance personnel, administration personnel). By reading the installation profile in conjunction with IEC 61918, these persons immediately know which requirements are common for the installation of all CPs and which are modified or replaced. The conventions used to draft this document are defined in Clause 5.

The provision of the installation profiles in one standard for each CPF (for example IEC 61784-5-2 for CPF 2) allows readers to work with standards of a convenient size.

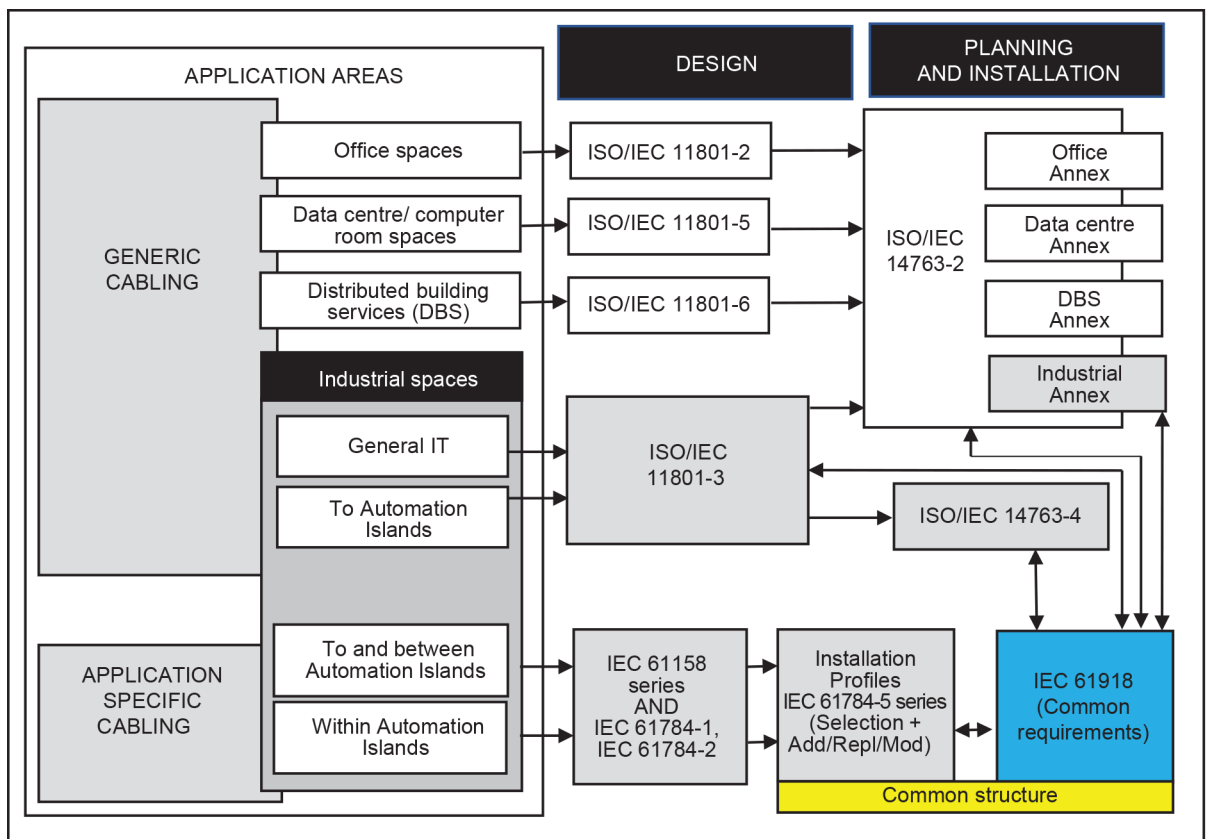

IEC

Figure 1 – Standards relationships

## INTRODUCTION to Amendment 1

This Amendment 1 includes the following significant technical changes with respect to IEC 61784-5-2:2018:

- a) Updated references of IEC 61918:2018 to include additions of IEC 61918:2018/AMD1:2022 and IEC 61918:2018/AMD2:2024,
- b) Added references for consideration of security to Subclause B.4.2.2,
- c) Updated optical fiber specifications and references in Subclauses B.4.3.3.2 and B.4.4.1.4,
- d) Added definition of electromagnetic compatibility options for conformance to Subclause B.4.4.1.2.1,
- e) Added support of mesh bonding systems to Subclause B.4.4 and Clause B.5,
- f) Added acceptance of end-to-end link verification and certification testing to Clause B.6.

## INDUSTRIAL COMMUNICATION NETWORKS – PROFILES –

### Part 5-2: Installation of fieldbuses – Installation profiles for CPF 2

#### 1 Scope

This part of IEC 61784-5 specifies the installation profiles for CPF 2 (CIP™<sup>1</sup>).

The installation profiles are specified in the annexes. These annexes are read in conjunction with IEC 61918:2018, IEC 61918:2018/AMD1:2022 and IEC 61918:2018/AMD2:2024.

#### 2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 61918:2018<sup>2</sup>, *Industrial communication networks – Installation of communication networks in industrial premises*  
IEC 61918:2018/AMD1:2022  
IEC 61918:2018/AMD2:2024

NOTE For profile specific normative references, see Clauses A.2, B.2, and C.2.

---

<sup>1</sup> CIP™ (Common Industrial Protocol) is a trade name of ODVA, Inc. This information is given for the convenience of users of this International Standard and does not constitute an endorsement by IEC of the trademark holder or any of its products. Compliance to this document does not require use of the trade name CIP™. Use of the trade name CIP™ requires permission of ODVA, Inc.

<sup>2</sup> The normative references of IEC 61918:2018, Clause 2, IEC 61918:2018/AMD1:2022, Clause 2 and IEC 61918:2018/AMD2:2024, Clause 2, apply.